

DBM – GEO.COIL DLL



01/03/2016 Ver. 2.1.0.0



TABLE OF CONTENTS

Brief description/License agreement	4
License agreement	4
Installation	5
DLL Usage	6
Usage from VB-VBA	6
Usage from C++	8
Contents of calcdll.h	8
Input array description	9
Automatic coil selection	13
Results array description	14
Default values	16
Tables	17
Error codes	22
Notes on DLL usage	25
Steam coils	25
Selection notes and physical limits for steam coils	27
Minimum headers/connections diameters according to number of supplied lines of tubes	27
Steam related error codes	27
Direct expansion coils	28
Inputs values limits and default parameters	28
Direct expansion coils with stainless steel tubes	28
Capillars pressure drop – ratio between capillars pressure drop and coil pressure drop	28
Standard configurations	29
Definitions and design limit for ED coils	30
A (Number of gas circuit: 1)	30
B (Number of gas circuit: 2)	31
C (Number of gas circuit: 3)	31
E (Number of gas circuit: 4)	31
Automatic refrigerant circuits selection	32
A (Number of gas circuits: 1)	32
B (Number of gas circuits: 2)	32
E (Number of gas circuits: 4)	32
F (Number of gas circuits: 6)	33
Default values for headers diameter according to single gas circuit capacity	33
Definitions and design limits for refrigerant condenser coils	34



Standard configurations	34
Refrigerant circuits - manual and automatic selections	35
Inlet and outlet headers diameters according to each refrigerant circuit capacity	35
Certifications, tolerances on capacity, air side and water side pressure drops	36
Fins thickness for coils with inox, fe, cuni and cu 1.00 tubes	38
Electro tinned fins	38
Standard threaded connections material	38
Available materials for tubes, fins and possible fins pitches	39
PED and maximum coils working conditions	42
GEOMETRY P3012	42
Single phase coils	42
Refrigerant condensers and evaporators	42
GEOMETRIES P60 / P40	43
Single phase coils	43
Steam coils	43
Refrigerant condensers and evaporators	43
VERSIONS	44



BRIEF DESCRIPTION/LICENSE AGREEMENT

In order to use the coil selection software CALC98 as a step in a more general design process, calcdll.dll is available for use with any programming language that supports standard Windows DLL: the user can insert the required input data and obtaining results supplying proper parameters to the exported function StartJob. Please note that only a minimal check is performed on the validity of the values supplied; this could lead to unpredictable results if wrong data are specified. It is left to the user to assure data consistency. The batch version of Calc98 is distributed under the following conditions:

LICENSE AGREEMENT

The software belongs to D.B.M S.p.a. / GEO.COIL S.r.l. and it has to be considered a tool to improve business relationship with their customers.

It is forbidden to use the software to facilitate in any way any of D.B.M. S.p.a. / GEO.COIL S.r.l. competitors. It is forbidden to distribute it to any third party unless written request is sent to D.B.M. S.p.a. / GEO.COIL S.r.l. and a written confirmation is received.

D.B.M. S.p.a. / GEO.COIL S.r.l. decline every responsibility deriving from the use of this software, even though they are convinced that it provides accurate results under standard design conditions. It is anyway suggested that expert and skilled persons check all the software outputs carefully.

D.B.M. S.p.a. / GEO.COIL S.r.l. reserves the right to revoke the program license with written advice (fax, e mail, mail) in any moment and without any specific reason. D.B.M. S.p.a./ GEO.COIL S.r.l. can at any time asks for the deletion of this software in every customer's computers.

If it will be discovered that this DLL has been used to order products to D.B.M. S.p.a. / GEO.COIL S.r.l. competitors we reserve the right to ask for damages.

The use or the installation of the program automatically implies the acceptance of all these conditions as well as our standard sales terms unless a different agreement is signed.

The software might be distributed with time operating limit. After that time expires, the DLL might not work anymore.

Please contact DBM sales office for any further information.



INSTALLATION

The files needed for a correct use of the DLL are:

File name	Description
CALCDLL.DLL	Simple wrapper against CALC98 MFC DLL extensions.
HHSD.DLL	Monophase engine
LIQUIDI.DLL	Fluids database
GAS.DLL	Gases database
EVAP.DLL	Evaporator engine
COND.DLL	Condenser engine
CMPDLL.DLL	Calc98 common library
LIQUIDI.DLL	Liquid library
Przinfo.dlt	Price file, from version 1.6

WARNING

DLLs are written with Visual C++ 2010, and the user needs to distribute the VC++ runtime also. The runtime can be downloaded from ALTEC site:

www.altecsoftware.com

login as

USER:ALTEC

PWD:ALTEC

The correct file to download is :VCRedist_x86_2010.exe

The DLL is compiled as UNICODE.

PRICE FILE

Starting from version 1.6, the price information are stored in a separate file for easier update. This version of the DLL uses standard Windows cryptoAPI features. Be sure to place the file in the same folder as Calcdll.dll



DLL USAGE

Calcdll.dll exports two functions.

1. StartJob, that accepts three parameters

double aInputData[NINPUTDATA], specifies input data

VARIANT aResData[NRESDATA], contains calculation results

VARIANT aOptions[NOPTIONSDATA], specifies optional flags (for future use)

NINPUTDATA: **100**

NRESDATA: **100**

NOPTIONSDATA **1**

2. SetPricePath(char path[255])

To set the path where przinfo.dlt file is located.

To avoid DLL location problems, check that Calcdll.dll, hhsd.dll, liquidi.dll, cmpdll.dll, gas.dll, evap.dll, cond.dll are placed in the same directory of your executable file.

Usage from VB-VBA

Function declaration

Declare Function StartJob Lib "c:\calcsoft\calcdll\debug\calcdll.dll" (ByRef p1 As Double, ByRef p2 As Variant, ByRef p3 As Double) As Boolean

Declare Function SetPricePath Lib "c:\calcsoft\calcdll\debug\calcdll.dll" (ByRef p1 As String)

Const NINPUTDATA = **100**

Const NRESDATA = 100

Const NOPTIONSDATA = 1

Const P60 = 1

where "c:\calcsoft\calcdll\debug\calcdll.dll" is the absolute path of calcdll.dll

Usage

Function StartCalc Clicked()

Dim bErr As Boolean



```
Dim aInputData(NINPUTDATA) As Double  
Dim aResult(NRESDATA) As Variant  
Dim aOptions(NOPTIONSDATA) As Variant
```

```
On Error GoTo StartCalc_exit
```

```
' Collect data from input mask
```

```
aInputData(0) = 1 ' coil type P60  
aInputData(1) = 32 ' inlet temperature 32°C  
aInputData(2) = 50 ' 50% R.H.  
aInputData(5) = 2000 ' air volume 2000 Sm3/h  
aInputData(14) = 4 ' 4 Rows  
aInputData(15) = 10 ' 10 tubes per row  
aInputData(16) = 2 ' fin pitch 2.0 mm  
aInputData(17) = 4 ' 4 circuits  
aInputData(18) = 500 ' coil length 500 mm  
aInputData(26) = 7 ' water inlet temp 7 °C  
aInputData(27) = 12 ' water outlet temp 12 °C  
' DLL DBM  
SetPricePath(".\\")
```

```
a = StartJob(aInputData(0), aResult(0), aOptions(0))
```

```
' show data results
```

```
' ShowResult(aResult)
```

```
Msgbox("Selected coil" & aResult(29))' Simple result processing
```

```
exit sub
```

```
StartCalc_exit:
```

```
MsgBox("Errors during calculation")
```

```
Resume next
```

```
End function
```

Note: Please remember that the first array position is 0, so you find the coil description in aResult(29).



Usage from C++

// Calcdll.h is located in the installation directory together // with calcwin.dll and calcwin.lib

```
#include "calcdll.h"
```

```
void CCalcdllsvrView::OnCalcolo()
```

```
{
```

```
    // TODO: Add your control notification handler code here
```

```
    VARIANT aRis[NRESDATA];
```

```
    double aInp[NINPUTDATA];
```

```
    double aOpt[NOPTIONSDATA];
```

```
    // Collect data from input mask
```

```
    GetData(vInp);
```

```
    // Check for errors
```

```
    if (!StartJob(aInp, aRis, aOpt))
```

```
        return;
```

```
    // Show results
```

```
    ShowResults(aRis);
```

```
}
```

Link Calcdll.lib together with your files.

Warning: positions 14,15 and 30 of the output array contain BSTR values, so in order to convert them to CString (in Visual C++) is possible to create an instance of the class CString passing *aRis[n].bstrVal* to the constructor (see VARIANT structure declaration):

```
CString coilDescription (aRis[29].bstrVal);
```

```
AfxMessageBox(CString("Coil type: ") + coilDescription);
```

Contents of calcdll.h

```
#define NINPUTDATA      100
```

```
#define NOPTIONSDATA    1
```

```
#define NRESDATA 100
```

```
extern "C" BOOL FAR PASCAL EXPORT StartJob(double vInp[NINPUTDATA], VARIANT vRis[NRESDATA], double vOpt[NOPTIONSDATA]);
```

Note: Arrays in C/C++ are 0-based (first position is position number 0), so you find the coil description in aRis[29].



INPUT ARRAY DESCRIPTION

Each position of the input array specified as the first parameter in StartJob contains a value related to a variable used by the software according to the following table:

Cell	Meaning	Measure unit/values
1	Coil type ¹	
2	air inlet temperature	°C
3	air inlet humidity	A value between 0 and 100
4	air inlet absolute humidity	g/kg
5	air inlet wet bulb	°C
6	Air volume (standard conditions)	Sm ³ /h
7	Air volume (normal conditions)	Nm ³ /h
8	Air volume (actual conditions)	Em ³ /h
9	Header material ²	
10	Air volume (standard conditions)	Sm ³ /s
11	Air volume (normal conditions)	Nm ³ /s
12	Air volume (actual conditions)	Em ³ /s
13	Air weight	kg/h
14	Air weight	kg/s
15	Number of rows	
16	Number of tubes	
17	Fin pitch ³	mm (0: auto select)
18	Number of circuits	
19	Coil width	mm
20	Coil height	mm
21	Capacity	kCal/h
22	Capacity	kW
23	Air outlet temperature	°C
24	Air inlet velocity	Sm/s
25	Air inlet velocity	Nm/s
26	Air inlet velocity	Em/s

¹ P60: 1, P3012: 2, P30: 13., P40:94. See table 6

² See table 10

³ See table 8



27	Fluid inlet temperature	°C
28	Fluid outlet temperature	°C
29	Fluid volume	dm ³ /s
30	Fluid volume	dm ³ /h
31	Fluid weight	kg/s
32	Fluid weight	kg/h
33	Max allowed fluid side pressure drop	kPa
34	Working pressure	bar
35	Working pressure	atm
36	Working pressure	kpa
37	Working pressure	kg/m ²
38	Working pressure	mmHg
39	Working pressure	mmH ₂ O
40	Tube-side fouling factor	m ² °C/W
41	Glycol type	1 – Ethylenglycol 2 – Propilenglycol 4 - Ethilen Alcohol
42	Glycol percentage - by volume	a number between 0 and 100
43	Glycol percentage - by weight	a number between 0 and 100
44	Safety factor on surface	a number between 0 and 100
45	Safety factor on capacity	
46	Fluid type ⁴	
47	Fluid density ⁵	kg/m ³
48	Fluid viscosity	mPa.s
49	Fluid specific heat	J/kg°C
50	Fluid conductivity	W/m°C
51	Frame code ⁶	
52	Price multiplier	
53	Fouling factor – fins side	m ² °C/W
54	Condensing pressure	bar
55	Condensing temperature	°C

4 See Table 5. **FRAME THICKNESS IS AUTOMATICALLY SET WITH DBM STANDARD RULES**

5 Specify lines from 47 - 50 only when line 46 contains 3 (USER-DEFINED FLUID)

6 See Table 11



56	Evaporating pressure	bar
57	Evaporating temperature	°C
58	Subcooling	°C
59	Superheating	°C
60	Type of calculation	1: Monophase 2: Direct expansion 3: Condenser
61	Fins material ⁷	
62	Fins thickness ⁸	mm
63	Tube thickness	mm (P60: 0.4, 0.75, 1.00 P3012 0.35, 0.6)
64	Flanges	0: No , other options not available
65	Tube material	0: CU – 1: CuSn – 2: INOX304 – 3 INOX316 – 4 FE 5 – CUNI9010
66	Customer field1	
67	Customer field2	
68	Customer field3	
69	Connection side	0:same side 1: opposite side. ED Coils always same side
70	Overall dimension – width ⁹	mm. Specify overall height also, or finned height
71	ARI Version	0: Std calculation 1: ARI calculation
72	Type of fins	0: finned coils – 1: coil without fins
73	Automatic coil selection	0: std coil: 1 cheapest geometry selection
74	Number of gas circuits	1,2,3 or 4. Only for condenser and evaporator coil. (0 = auto selection)
75	Overall dimension – height	mm.
76	Steam coil: execution type	1-3-6 ¹⁰
77	Electro tinned after manufacturing	0: No 1: yes. Available only if CuSn tubes and fins are selected. Not all frame materials are suitable for electro tinning. We recommend Cu if coil weight is < 300 Kg

⁷ See Table 7

⁸ See Table 12

⁹ Alternative option for coil width. See row 19

¹⁰ 1: Sloped tubes – 3:Vertical tubes - 6 Headers on same side. Default value 1



78	Calculation mode	0: standard tolerance 1: reduced tolerance 2 certified performance 3: compatibility mode (performance as previous DLL version)
79	Inlet manifold diameter ¹¹	0: Auto else See table 13
80	Outlet manifold diameter ¹²	0: Auto else See table 13
81	Type, material and thickness of basin ¹³	See table 15.
82	Drop eliminator	See table 14
83	Packing type	0: None 1: crate 2: pallet 3: wooden box
84	Minimum height of bottom frame metal sheet	mm. Standard value = 0
85	Minimum height of top frame metal sheet	mm. Standard value = 0. Position 84 and 85 must be both 0 or greater than 0. These values are used only for selection with overall dimensions

Table 1: Input values

It is possible to set the value for some parameters in several ways or with different measure units. So, there are groups of lines for which only one value is required. If more than one value is supplied (as a mistake), the default value (if specified) or the first valid value is used: if you specify, for example, values for rows **6,7,9** in table 1, the data in the row **6** is assumed as valid; if you specify values for rows **9,10,14**, the value in row 9 is used. The default row numbers used when multiple choices are available are listed in Table 2.

Lines	Meaning	Default value
6,7,8,9,10,11,12,13,14,24,25,26	Air volume/weight/velocity	6
16, 20	N° tubes/Coil height	16
21,22	Capacity required	21
21,15	Capacity/N° Rows	21
28,29,30,31,32	Fluid outlet temp/Fluid	28

¹¹ Enter the input value specified in Table13. If the user wants to specify more than one manifold, add to the value the number of manifold multiplied by 100, so 110 is the correct value for 1 manifold DN150, 210 is the correct value for 2 manifolds DN150. Values less than 100 are treated as a single manifold. The maximum number of manifolds is 3

¹² Same as note 11

¹³ Thickness of intermediate tray is automatically calculated, based on material and coil length. Thickness of flat tray and sloped tray can be specified with the correct input value



	volume/weight	
34,35,36,37,38,39	Working pressure	34
42,43	Glycol percentage	43
54,55	Condensing pressure/temperature	54
56,57	Evaporating pressure/temperature	56

Table 2. Default values

AUTOMATIC COIL SELECTION

This feature, when enabled, selects the cheapest coil between P60,P3012 and P40 for the specified duty required. The following assumptions are made on input values:

- The coil height is specified (the number of tubes, if specified, is converted to a height value)
- A selection calculation is required: this option is not available when the user specifies the number of rows in position 15 of the input array.
- The fins pitch is always automatically selected, starting from the value entered in position 17 of the input array. The DLL considers this as the minimum fin pitch for the selection, while the maximum value is 5.
- The tube thickness is automatically selected. The comparison is between P3012 -0.35 mm and P60/P40 0.4 mm or P3012 0.6 mm – P60/P40 0.75 mm (specify 0.75 in position 63 of the input array). The tube thickness selected is available in the results array.
- The fins thickness is the same for both geometries. The value is specified in position 62. The DLL does not check for validity of the specified value.



RESULTS ARRAY DESCRIPTION

The second parameter specified in StartJob call contains the results related to the data specified in the input array. The meaning of each position in the array is given in Table 3.

Cell	Meaning	Measure unit
1	Capacity	kW
2	Capacity	kcal/h
3	Air outlet temperature	°C
4	Air outlet relative humidity	%
5	Air outlet absolute humidity	g/Kg
6	Fluid outlet temperature	°C
7	Fluid volume	dm ³ /h
8	Fluid volume	dm ³ /s
9	Fluid weight	kg/h
10	Fluid weight	kg/s
11	Air side pressure drop	Pa
12	Fluid side pressure drop	kPa
13	Capacity Reserve	%
14	Coil height	mm
15	Coil depth	mm
16	D dimension	mm
17	Gas velocity	m/s
18	Fluid velocity	m/s
19	Fluid density	kg/m ³
20	Fluid viscosity	mPas
21	Fluid specific heat	J/Kg°C
22	Fluid conductivity	W/m°C
23	Sensible Heat/Total heat ratio	
24	Condensed water	kg/h
25	Error code ¹⁴	
26	Number of rows	
27	Number of circuits	
28	Coil price	
29	Coil weight	kg
30	Complete coil denomination	
31	Subcooling	°C
32	Superheating	°C
33	Vapour fraction	
34	Inlet connection diameter	DN or ”

¹⁴ See Paragraph 7



35	Outlet connection diameter	DN or “
36	Vapour velocity inside inlet manifold	m/s
37	Vapour velocity inside tubes	m/s
38	Liquid velocity inside tubes	m/s
39	Liquid velocity inside outlet manifold	m/s
40	Number of distributors	
41	Distributors denomination	
42	Capillars outside diameter	mm
43	Capillars inside diameter	mm
44	Capillars length	mm
45	Distributor header diameter	mm
46	Condensing temperature	°C
47	Condensing pressure	bar
48	Evaporating temperature	°C
49	Evaporating pressure	bar
50	Total exchange surface	m ²
51	Freon pressure drop	°C
52	Inlet air relative humidity	%
53	Internal volume	m ³
54	Fins pitch	mm
55	Customer code	
56	Coil finned length	mm
57	Tubes number	
58	Tube thickness	mm
59	Coil overall length (standard DBM)	mm
60	Coil overall height (standard DBM)	mm
61	Drop eliminator pressure drop	pa
62	Drain tray price	€
63	Drop eliminator price	mm
64	Not used	
65	Number of coils	
66	Distance between manifolds (X) for water coils and single manifold	mm
67	Distance between manifolds (Y) for water coils and single manifold	mm
68	Number of gas circuit	
69	Coil needs drawing confirmation	
70	Frame thickness: is always computed according with DBM standard	mm
71	Warning code	See error table



72	Fins thickness	mm
73	Connection side	1 same side, 2 opposite side
74	Air side pressure drop, dry mode	Pa
75	Frame length on bends side (standard DBM)	mm
76	Capillars pressure drop (for ED coils)	Bar
77	Height of bottom and top frame plate (standard DBM)	mm

Table 3. Results array description.

DEFAULT VALUES

It is possible to specify only a minimum set of values in order to perform a selection.

For the parameters without value (that is, with value 0) default values will be assumed, according to the following table:

Row	Meaning	Default value
34	Working pressure	1.013 bar
40	Tube side fouling factor	0 m ² C/W
42	Glycol percentage	0
44	Safety factor on surface	0
45	Safety factor on capacity	0
46	Fluid type	1 (water)
53	Gas side fouling factor	0 m ² C/W

Table 4: default values for empty rows.



TABLES

Fluid type	Value
Water	1
ESSOTHERM 500	2
R134a	4
R22	5
Steam	9
Therminol 66	11
R407C	12
R404A	13
R410A	16
Sea water (100g/kg)	10
R407F	72

Table 5: Fluid types

Coil type	Value
P60	1
P3012	2
P40	94

Table 6: Coil types

P60	P3012	P40
2	2	2
2,5	2,5	2.5
3	3	3
4	4	4
5	5	5
6	6	6
8		7
10		8
		10
		12

Table 8: Available fins pitches (mm)

Fin material for P60-P3012-P40 coils	Value
AL	1
ALPR	2
CU	3
CUSN	4
ALMG 2.5	9

Table 7: Fin material



Header material	Value
Steel	6
Copper	1

Table 10: Header material

For INOX tubes, manifolds material is INOX

For Fe tubes, manifolds material is Fe

N.B.: Starting from version 1.7.0.0 the manifold material is ALWAYS equal to tube material

Frame	Value
Al 2 mm	15
Al 3 mm	40
FeZn 1,5 mm	11
FeZn 2,0 mm	12
FeZn 2,5 mm	13
FeZn 3 mm	14
FeZn 4 mm	43
Inox 304 1,5 mm	16
Inox 304 2 mm	17
Inox 304 2,5 mm	18
Inox 304 3 mm	39
Inox 304 4 mm	41
Inox 316 1,5 mm	25
Inox 316 2,0 mm	36
Inox 316 2,5 mm	37
Inox 316 3 mm	38
Inox 316 4 mm	42
Fe 1,5 mm	45
Fe 2,0 mm	46
Fe 2,5 mm	47
Fe 3 mm	48
Fe 4 mm	49
Cu 2 mm	19
Cu 3 mm	44

Table 11: Frame codes



Fin thickness P60	Value
	(mm)
Al	0,11
Al	0.20
AlPR	0.11
Cu	0,10
CuSn	0.10
AlMg2.5	0.15

Table 12: Valid fins thick.(P60)

Fin thickness P3012	Value
	(mm)
Al	0,11
Al	0.20
AlPR	0,11
Cu	0,10
Cu	0.20
CuSn	0.10
CuSn	0,20
AlMg2.5	0.15

Table 12: Valid fins thickness (P3012)

Fin thickness P40	Value
	(mm)
Al	0,11
Al	0.20
Al	0.25
Al	0.40
AlPR	0.11
AlPR	0.25
Cu	0,10
Cu	0.20
CuSn	0.10
CuSn	0.20
AlMg2.5	0.15
AlMg2.5	0.20

Table 12: Valid fins thickness (P40)



Input value	Manifolds diameter	Manifolds diameter
2	DN 20	¾"
3	DN 25	1"
4	DN 32	1" ¼
5	DN 40	1" ½
6	DN 50	2"
7	DN 65	2" ½
8	DN 80	3"
9	DN 100	4"
10	DN 125	5"

Table 13: Manifolds diameter

Input value	Drop Eliminator type	Frame material
50	Plastic 33 mm pitch	Integrated into coil
51	Plastic 33 mm pitch	Separate – Galvanized steel
52	Plastic 33 mm pitch	Separate – Aluminum
53	Plastic 33 mm pitch	Separate – INOX 304
54	Plastic 33 mm pitch	Separate – INOX 316

Table 14: Drop eliminator type

Input value	Flange type	Flange material
203	EN 1092 Type 13 PN16	Inox 304
206	EN 1092 Type 13 PN16	Steel
217	EN 1092 Type 13 PN 16	Inox 316
303	EN 1092 Type 01 PN 16	Inox 304
306	EN 1092 Type 01 PN 16	Steel
317	EN 1092 Type 01 PN 16	Inox 316
403	EN 1092 Type 11 PN 16	Inox 304
406	EN 1092 Type 11 PN 16	Steel
417	EN 1092 Type 11 PN 16	Inox 316
503	EN 1092 Type 02 PN 16	Inox 304
506	EN 1092 Type 02 PN 16	Steel
517	EN 1092 Type 02 PN 16	Inox 316

Table 16: Flanges type and material

**NB: TO CALCULATE THE PRICE FOR COUNTERFLANGES ADD
400 TO THE ABOVE CODE: i.e.906 = EN 1092 Type 02 PN 16 Steel
+ counterflanges**



Input value	Basin type	Material
1011	Flat	Galvanized steel 1.5 mm
1012	Flat	Galvanized steel 2.0 mm
1013	Flat	Galvanized steel 2.5 mm
1014	Flat	Galvanized steel 3.0 mm
1015	Flat	Aluminum 2.0 mm
1016	Flat	Inox 304 1.5 mm
1017	Flat	Inox 304 2.0 mm
1018	Flat	Inox 304 2.5 mm
1025	Flat	Inox 316 1.5 mm
1036	Flat	Inox 316 2.0 mm
1037	Flat	Inox 316 2.5 mm
1038	Flat	Inox 304 3.0 mm
1040	Flat	Inox 316 3.0 mm
2011	Sloped	Galvanized steel 1.5 mm
2012	Sloped	Galvanized steel 2.0 mm
2013	Sloped	Galvanized steel 2.5 mm
2014	Sloped	Galvanized steel 3.0 mm
2015	Sloped	Aluminum 2.0 mm
2016	Sloped	Inox 304 1.5 mm
2017	Sloped	Inox 304 2.0 mm
2018	Sloped	Inox 304 2.5 mm
2025	Sloped	Inox 316 1.5 mm
2036	Sloped	Inox 316 2.0 mm
2037	Sloped	Inox 316 2.5 mm
2038	Sloped	Inox 316 3.0 mm
2039	Sloped	Inox 304 3.0 mm
2040	Sloped	Aluminum 3.0 mm
3007	Intermediate	Galvanized steel
3002	Intermediate	Aluminum
3003	Intermediate	Inox 304
3017	Intermediate	Inox 316

Table 15: Basin type and material

NB: TO CALCULATE THE PRICE FOR BOTH INTERMEDIATE TRAY AND FLAT/SLOPED TRAY, ADD 3000 TO THE ABOVE CODE: i.e.5038 = SLOPED TRAY INOX316 3mm + INTERMEDIATE TRAY INOX316



ERROR CODES

If you specify wrong input data, error codes are returned according to the following table:

Error code	Error description
-99	Unknown error
130	Maximum number of connected rows exceeded
131	Steam velocity too high. Please contact DBM
150	License expired
151	Unable to load standard coils. Be sure to call InitLib() before StartJob()
10100	Fin pitch not allowed
10200	Wrong circuits number or wrong max liquid side pressure drop
10300	Calculation type not specified
10305	Invalid gas or liquid temperatures
10306	Wrong liquid temperature. Minimum temperature difference is 1°C between air and liquid, suggested value is 3C°
10310	Invalid fin pitch for ratings mode
10400	Wrong liquid type
10500	Wrong user specified liquid properties
10600	Liquid outlet temp. and liquid volume not specified
10700	Incorrect tubes number or coil height
10750	Incorrect coil length
10800	Incorrect inlet air condition
10900	Incorrect gas side volume or weight
11000	Wrong coil type
11010	Wrong frame code
11020	Invalid fin thickness or fins pitch
11030	Invalid tube thickness
11040	Invalid header material
11050	Invalid tube material
11070	Overall length or height not specified correctly
11080	Steam coils dimensions invalid.
11090	Invalid steam coil execution: valid values for input[46] are 1,3,6
11100	Invalid temperature or pressure for evaporator or condenser
11200	Invalid inlet refrigerant conditions (error in computing vapour fraction)
11300	Condenser or evaporator module not found
11310	Evaporating temperature is too low (minimum value -20°C)
11320	Minimum fins pitch is 3.0 (see direct expansion coil selection note)
11330	ETAM is available only for CuSn tubes and fins
11340	Invalid basin type or material



11350	Invalid drop eliminator
11360	Invalid packing code
11370	Invalid flange material
11380	Invalid flange type
11390	Flanges must be selected for this temperature conditions
11400	Error in price calculation. Check for przinfo.dlt file
11401	Error with tubes price
11402	Error with fins price
11403	Error with frame price
11404	Error with inlet manifold price
11405	Error with outlet manifold price
11410	Invalid number of rows or circuits
11420	Maximum fin pitch for AlMg is 3.0 mm
11430	Tube temperature is too high for the selected material and thickness
11440	Minimum temperature is -45°
11450	Maximum copper manifold temperature is 160°C. Select Steel manifold
11460	Minimum temperature is -10° for steel tubes and manifolds
11470	Wrong package code
11480	Maximum finned size for electro tinned (ETAM) coil is 5600Lx1700Hx400D
19000	Invalid tube thickness. Check the minimum tube thickness based on selection type and geometry type. Especially for R410 selection, due to working limits, is often necessary to set 1.0 mm tube thickness
40000	Number of circuit not valid. Decrease number of circuit, increase max pressure drop or increase liquid volume
41100	The minimum difference between inlet temperature of fluids should be at least 3°
41110	It is suggested to use ARI calculation mode
41120	It is suggested to use ARI mode and a fin pitch of 3.0 mm or wider
41140	It is suggested a fin pitch of 2.5 minimum
41150	The results cannot be guaranteed in this working conditions
41160	The results need DBM check
41170	It is suggested to use glycol
41180	It is not possible to select air velocity and overall length
41190	Steam velocity too high. Please contact DBM

Table 8: wrong input error codes.

If the calculation engine fails during iterations, the error code returned is listed in table 9.

Error code	Error description
------------	-------------------



10xx	Unknown error
20xx	General error
30xx	Liquid velocity out of allowable range
40xx	Out of temperature difference in iteration
50xx	Required capacity is too high
60xx	Endless loop
70xx	Liquid quantity is too high

Table 9: calculation engine error codes.




NOTES ON DLL USAGE

In the next pages there will be some suggestions to set up DLL correctly for specific applications like steam coils, direct expansion coils, condensers and other applications.


Steam coils

Standard configurations:


VAPORE 1

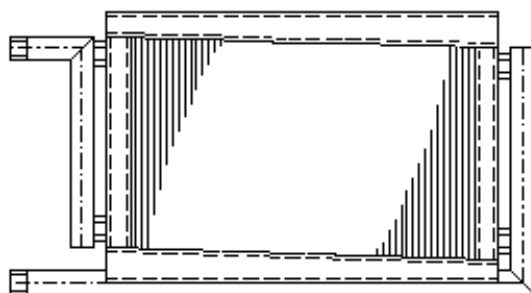

VAPORE 3

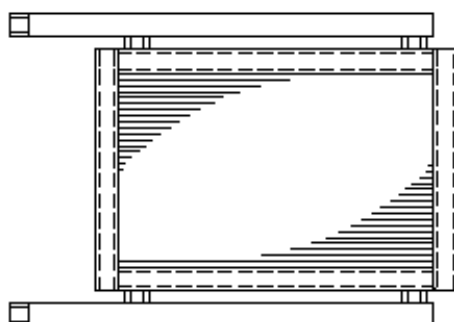

VAPORE 6

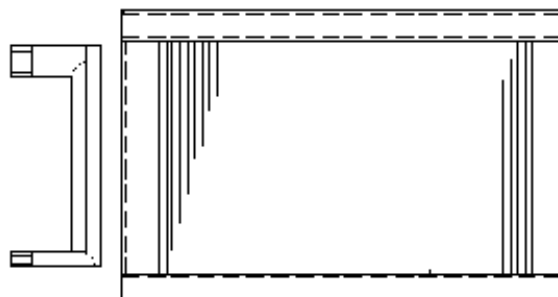

We always suggest to use configuration VAPORE 1 or VAPORE 3 with tubes in Stainless Steel (Inox304,



Inox316, thickness 1.00mm) or Carbon Steel (Fe, thickness 1.5mm). Configuration VAPORE 6 is possible but not recommended. Talking about Cu as tubes material: in most of the cases its use is possible however a technical evaluation is necessary case by case.

Geometry: compulsory to use P60 or P40. Geometry P0312 should not to be used for steam applications.

Here how to set up DLL correctly according to above comments:

Cell	Meaning	Measure unit/values
1	Coil type	1 or 94
46	Fluid type	9
60	Type of calculation	3
61	Fins materials	1-3-4-9 *
62	Fins thickness	0.20**
63	Tube thickness	0: default value=1.5 for Fe tubes, 1.0 for Inox tubes
65	Tube material	4 or 2 or 3
76	Steam coil: execution type ***	1 – 3

*

Pre-painted aluminium fins are not ok for steam applications because of too high temperature. Do not list them as available material.

**

With Fe or Stainless Steel tubes we suggest to use reinforced fins (minimum thickness 0.20 mm)
Standard fins thickness is possible but with very bad aesthetical results

1 = Configuration "VAPORE 1"

3 = Configuration "VAPORE 3"

The connection side(input values cell 69) is automatically selected by the DLL for steam coils according with steam coil execution

Important note: for execution VAPORE 3 height and length (both overall and finned) have to be inverted.



Selection notes and physical limits for steam coils

Maximum steam velocity inside tubes: 20 m/s

Execution	Min. Steam pressure [bar(a)]	Max finned length [mm]	Max finned height [mm]
Vapore 1	0	4000	2400
Vapore 3	0	2400	3000
Vapore 6	3	1500	2400

If bigger dimensions are needed, it is recommended to split the coil in order not to exceed suggested measures.

Minimum headers/connections diameters according to number of supplied lines of tubes

Tubes material	N° of tubes lines supplied	Minimum headers diameter
Cu	1	1"
	2	2"
	3	3"
	4	4"
Fe	1	1"
	2	2"
	3	4"
Inox304-316	1	1"
	2	2"
	3	4"
CuNi9010	1	1"
	2	2"
	3	4"

Steam related error codes

Error code	Error description
41190	Steam velocity too high. Please contact DBM
131	Steam velocity too high. Please contact DBM
11090	Invalid steam coil execution: valid values for input[46] are 1,3,6
11080	Steam coils dimensions invalid.
130	Maximum number of connected rows exceeded.



Direct expansion coils

Inputs values limits and default parameters

Evaporating temperature: minimum allowable value is -20°C

If evaporating temperature is $\leq 1^{\circ}\text{C}$ fins pitch must be $\geq 3.0\text{mm}$ (only for heat pumps systems lower fins pitch can be allowed).

Default values for superheating: 5 K - Subcooling: 2 K. If zero is specified for these values in input[58] and input[59] then the default values is used..

IMPORTANT: Evaporating temperature or pressure (Inputs 57 and 56). This is the temperature/pressure at the outlet of the coil at the suction header. Please note that this temperature is different from the temperature at the coil tubes inlet. For particular refrigerants with high temperature glide (e.g. r407c) there can be up to 6K between inlet and outlet. Calc selecting such type of coils consider the mean temperature corrected by refrigerant title at distributor inlet and tubes pressure drop. However the nominal evaporating temperature is the one you can measure at the suction (this means that real average evaporating temperature will be lower with some refrigerants).

Direct expansion coils with stainless steel tubes

Do not use DLL to select direct expansion coils with stainless steel tubes. Thermal results are correct however following restrictions apply:

- Refrigerant circuits can only be stacked (not interlaced)
- Capillars are only available in diameters 6 and 8mm.
- Distributors are available only up to 20 circuits
- Overall sizes and frame depth are not correct
- Prices are not correct

Capillars pressure drop – ratio between capillars pressure drop and coil pressure drop

A very important parameter to consider in the design of direct expansion coils is the pressure drop through the capillars. This value is the position 76 in the result array

DBM recommends a minimum value for the pressure drop of 0.5 Bar and a maximum value of 1.5 Bar.

However it is very important to consider how the coil will work. If coil will have to provide a big swing of capacity between maximum and minimum load it is better to use a high value of pressure drop (e.g. DX coils for marine applications with a design air inlet temp. of 35°C 70% which have to work also with much lower inlet temperatures and humidities) and stay around 1.0/1.5 Bar. If coil will work at a constant load also low values are ok. To increase the pressure drop you have to decrease number of circuits. The opposite to



increase it.

Another important value to consider is the ratio between capillars pressure drop and the refrigerant pressure drop inside the coil (output position 12): in order to have a correct refrigerant distribution such ratio must be at least 3 (considering worst operating condition).

Example:

Refrigerant pressure drop inside the coil = 19.2 Kpa = 0.192 Bar

Capillars pressure drop = 0.64 Bar



Ratio = $0.64 / 0.192 = 3.33$ --> OK ! Coil will work properly.

In case ratio value is lower than 3 correct refrigerant distribution cannot be guaranteed.




IMPORTANT: direct expansion coils must be selected considering the application. This because some selection parameters are related to the application (e.g. capillars pressure drop). It means that DBM cannot guarantee that they will be suitable for the application.

Standard configurations

Interlaced



Separate / Partly interlaced





STANDARD CONFIGURATIONS

DEFINITIONS:

A = 1 Refrigerant circuit

B = 2 Interlaced refrigerant circuits

C = 3 Interlaced refrigerant circuits

D = 2 Stacked refrigerant circuits

E = 4 Stacked and interlaced refrigerant circuits

F = 6 Stacked and interlaced refrigerant circuits

DEFINITIONS AND DESIGN LIMIT FOR ED COILS

Refrigerant circuits configurations can be specified or not. In the second case the DLL will use our standard configurations according to the number of circuits.

Cell	Meaning	Measure unit/values
74	Number of gas circuits	1 or 2 or 4. Only for condenser and evaporator coil.

If no value is specified for cell 74, the DLL will work with automatic selection mode and will choose refrigerant circuits according to DBM standard rules.

A (Number of gas circuit: 1)



Maximum number of circuits for each distributor:


	Capillars Ø [mm]		
	5	6	8
Maximum number of circuits (stock distributors)	30	30	30

- Maximum number of distributors connected together: 2

- Maximum number of circuits 60 (2 * 30)



B (Number of gas circuit: 2)




Maximum number of circuits for each distributor:

	Capillars Ø [mm]		
	5	6	8
Maximum number of circuits (stock distributors)	30	30	30

- Maximum number of distributors connected together: 2
- Maximum number of circuits 120 (2 * 2 * 30)


C (Number of gas circuit: 3)



	Capillars Ø [mm]		
	5	6	8
Max number of circuits for each distributor in stock	30	30	30

- Maximum number of distributors assembled together: 1
- Maximum number of circuits for the configuration: 3 x 30 = 90

E (Number of gas circuit: 4)



Maximum number of circuits for each distributor:

	Capillars Ø [mm]		
	5	6	8
Maximum number of circuits (stock distributors)	30	30	30

- Maximum number of distributors connected together: 1
- Maximum number of circuits 120 (4 * 1 * 30)



AUTOMATIC REFRIGERANT CIRCUITS SELECTION


A (Number of gas circuits: 1)



Maximum number of circuits for each distributor:


	Capillars Ø [mm]		
	5	6	8
Maximum number of circuits	34	34	30

B (Number of gas circuits: 2)



	Capillars Ø [mm]		
	5	6	8
Maximum number of circuits	34	34	30

E (Number of gas circuits: 4)




Maximum number of circuits for each distributor:

	Capillars Ø [mm]		
	5	6	8
Maximum number of circuits	34	34	30



F (Number of gas circuits: 6)



Maximum number of circuits for each distributor:

	Capillars Ø [mm]		
	5	6	8
Maximum number of circuits	34	34	30

Default values for headers diameter according to single gas circuit capacity


Headers (suction) diameters are automatically selected according to coils capacity listed on the following table

Refrigerant	Kcal/h						
R404A	7500	17000	29000	46000	94000	230000	360000
R507A	7500	17000	29000	46000	94000	230000	360000
R12	5000	10000	18000	30000	60000	140000	220000
R134A	5000	10000	18000	30000	60000	140000	220000
R22	9000	20000	35000	55000	110000	270000	420000
R407C	8100	18000	31500	49000	99000	240000	378000
R410A	8100	18000	31500	49000	99000	240000	378000
Diameter [mm]	22	28	35	42	54	80	90




DEFINITIONS AND DESIGN LIMITS FOR REFRIGERANT CONDENSER COILS


A




D




B



E



C



STANDARD CONFIGURATIONS

DEFINITIONS:

A = 1 Refrigerant circuit

B = 2 Interlaced refrigerant circuits

C = 3 Interlaced refrigerant circuits

D = 2 Stacked refrigerant circuits

E = 4 Stacked and interlaced refrigerant circuits



REFRIGERANT CIRCUITS - MANUAL AND AUTOMATIC SELECTIONS

User can choose number of refrigerant circuits (it is possible to specify configurations A, B, E only) using Cell 74.

Cell	Meaning	Measure unit/values
74	Number of gas circuits	1, 2, 3 or 4. Only for condenser and evaporator coil.

If no value is specified for cell 74, the DLL will work with automatic selection mode and will choose refrigerant circuits according to DBM standard rules.

If the number of gas circuit specified is zero, the DLL computes the number and type of refrigerant circuits automatically according to total coil capacity (one circuit will be added every time maximum capacity for bigger possible diameter is reached, refer to following table) following this order:

A = 1 Refrigerant circuit

B = 2 Interlaced refrigerant circuits

C = 3 Interlaced refrigerant circuits

E = 4 Stacked and interlaced refrigerant circuits

INLET AND OUTLET HEADERS DIAMETERS ACCORDING TO EACH REFRIGERANT CIRCUIT CAPACITY

Refrigerant	Kcal/h						
R404A	9300	21000	38000	63000	135000	315000	485000
R507A	9300	21000	38000	63000	135000	315000	485000
R134A	6000	13000	24000	37000	80000	185000	285000
R22	11000	25000	45000	70000	150000	350000	540000
R407C	10000	22000	42750	66000	142000	332000	513000
R410A	10000	22000	42750	66000	142000	332000	513000
Ø Inlet	22	28	35	42	54	80	90
Ø Outlet	22	22	22	28	35	54	54



INPUTS VALUES LIMITS AND DEFAULT PARAMETERS

Maximum circuit length is 20 m

Maximum refrigerant velocity inside tubes is 4.2 m/s

If finned height is > 2.1m DLL will automatically switch to configurations E and D (stacked refrigerant circuits)

CERTIFICATIONS, TOLERANCES ON CAPACITY, AIR SIDE AND WATER SIDE PRESSURE DROPS

Selection mode and tolerances on declared data can be defined through Cells 71 and 78.

CELL 71 is used to define if a coil needs to be certified according to AHRI, EUROVENT or simply according to DBM Standard.

If value is 0 selection mode is standard. If value is 1 selection mode is ARI. If value is 2 selection mode is Eurovent (not yet available).

ARI is a North American certification program on coils performances.

Important note: setting Cell 71 to AHRI / EUROVENT mode does not imply that coil can be AHRI / EUROVENT certified. There are some certification limits the DLL does not check. However coil is selected according to AHRI standard.

AHRI selection mode can only applied to water coils. DX, COND and STEAM coils are not currently certified. EUROVENT certification will apply to water, DX and COND coils but only to geometry P3012. Contact our office to know exactly where these certifications program can be applied.

AHRI and EUROVENT mode can be used only if Cell 78 value is 2 (Certified mode).

Cell	Meaning	Measure unit/values
71	AHRI Version	0: Std calculation 1: AHRI calculation; 2: Eurovent



CELL 78 is used to set the selection tolerances on declared capacity, air and water pressure drops. DLL can work with 3 pre-defined levels of accuracy referring to following parameters: capacity, air pressure drop, water pressure drop. Tolerances are the following:

Default calculation type	Nominal tolerance on capacity	Nominal tolerance on air side pressure drop	Nominal tolerance on water pressure drop
Standard tolerance	15%	15% or 10 Pa	15% or 5 Kpa
Reduced tolerance	10%	10% or 10 Pa	10% or 5 Kpa
Certified performance	05%	05% or 10 Pa	05% or 5 Kpa

Here available values for Cell 78:

0: standard tolerance
1: reduced tolerance
2 certified performance
3: compatibility mode (performance as previous DLL version)

IMPORTANT NOTES:

- For other thermodynamic declared data tolerances are not defined.
- Indicated tolerances are valid only for air conditioning applications with air velocity between 0.5 – 4.5 m/s and water velocity between 0.5 – 2.5 m/s. For special applications we always recommend to contact our sales office.
- Certified performance selection mode complies with Eurovent and AHRI-410 Standard technical requirements. However not all the materials, geometries, fluids have been certified.
- Indicated tolerances refer to a coil tested in a tunnel, with perfectly clean fins, without any fouling factor on the tubes side and with perfect air distribution across all coil surface (air flow perpendicular to coil face area). Reference standard is ASHRAE 33.
- Bare tubes coils are not tested
- Tolerances on capacity for heat recovery selections (twin coils): we do not guarantee tolerances on such type of selections. Reason is that often water and air temperatures are too close. We recommend to select such systems always in certified mode

Why different tolerances are necessary

We decided to introduce three levels of tolerances moving from following considerations:

- At the moment in Europe tolerances on declared performances are in the range of 10 – 20 % depending on the market, application and manufacturer. This is commonly called “Commercial factor”
- An increasing number of coils users is working to achieve performances certifications on their products. This means that they need a reliable instrument to size their equipment in order to avoid to oversize components.



In summary there are two main streams in the market moving towards different directions. In this way our customers can decide how to use our program but being aware of accuracy of the data they are using.

FINS THICKNESS FOR COILS WITH INOX, FE, CUNI AND CU 1.00 TUBES

For coils with Inox304, Inox316, Fe, CuNi9010 or CU 1.00mm thk we recommend to use at least 0.20mm thickness fins (if available in the desired material).

This mainly to have better aesthetical results. Thinner fins can be easily damaged during tubes expansion.

ELECTRO TINNED FINS

By CuSn fins and tubes we mean fins and tubes electro tinned after manufacturing. This means that fins and tubes are cut and then sent to a tinnery where Sn layer is applied.

Such method guarantees a complete Sn coverage on all cutting edges while pre-tinned materials have no protection on them.

The disadvantage is that fins will not look so good after the process. There will be scratches, small damages and their color will not be uniform. This is something we cannot avoid and it is related to the process.

STANDARD THREADED CONNECTIONS MATERIAL

For threaded connections standard materials please refer to following table;

Connections Ø	FRAME MATERIAL				
	Fe	FeZn	Inox304/316	Cu	Al
1/2" – 5"	Fe	Fe	Inox316	Inox316	Inox316

NOTES:

- Valid for coils with copper headers. For coils with stainless or carbon steel headers connections will be of the same headers alloy.
- Refrigerant condensers and direct expansion coils is supplied with plain copper connections.




AVAILABLE MATERIALS FOR TUBES, FINS AND POSSIBLE FINS PITCHES

P60

FINS											
FINS MATERIAL	Thickness [mm]	AVAILABLE FIN PITCHES [mm]									
		2.0	2.5	3.0	4.0	5.0	6.0	7.0	8.0	10.0	12.0
Al	0.110										
	0.200										
AlPr	0.110										
AlMg2.5	0.150										
Cu	0.100										
CuSn	0.100										

TUBES					
Material	Thickness [mm]				
	0.40	0.60	0.75	1.00	1.50
Cu					
CuSn					
CuNi9010					
Fe					
Inox304					
Inox316					

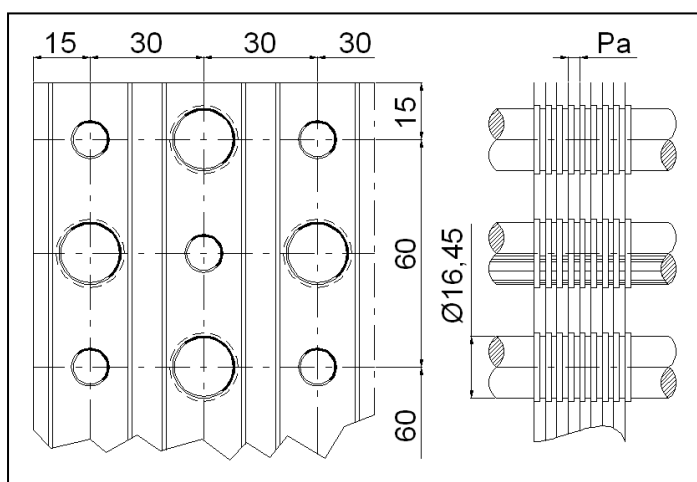




P40

FINS											
FINS MATERIAL	Thickness [mm]	AVAILABLE FIN PITCHES [mm]									
		2.0	2.5	3.0	4.0	5.0	6.0	7.0	8.0	10.0	12.0
Al	0.110										
	0.200										
	0.250										
	0.400										
AlPr	0.110										
	0.250										
AlMg2.5	0.150										
	0.200										
Cu	0.100										
	0.200										
CuSn	0.100										
	0.200										

TUBES					
Material	Thickness [mm]				
	0.40	0.60	0.75	1.00	1.50
Cu					
CuSn					
CuNi9010					
Fe					
Inox304					
Inox316					

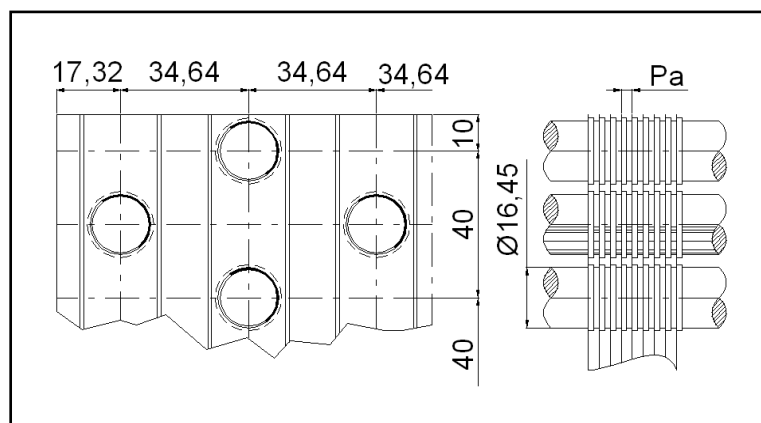




P3012

FINS											
FINS MATERIAL	Thickness [mm]	AVAILABLE FIN PITCHES [mm]									
		2.0	2.5	3.0	4.0	5.0	6.0	7.0	8.0	10.0	12.0
<i>Al</i>	0.110										
	0.200										
<i>AlPr</i>	0.110										
<i>AlMg2.5</i>	0.150										
<i>Cu</i>	0.100										
	0.200										
<i>CuSn</i>	0.100										
	0.200										

TUBES			
Material	Thickness [mm]		
	0.35	0.40	0.60
<i>Cu</i>			
<i>CuSn</i>			

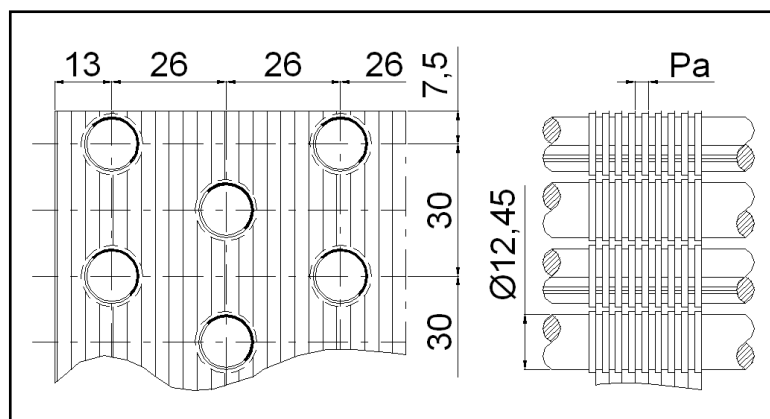

	= Available
	= Available with stellar collar
	= Available
	= Not available



PED AND MAXIMUM COILS WORKING CONDITIONS

The current implementation of the DLL does not have a complete check of maximum allowable working conditions and PED limitations. Here there are some tables listing maximum allowable working pressure for DBM geometries and materials.

Materials to be used are also related on maximum working conditions your company is declaring for equipment coils are installed in.

We recommend to warn the user to send selection to DBM for a check everytime there are temperatures over 120°C (air or internal fluid). This to avoid the risk of entering in PED Class III.

IMPORTANT NOTE ABOUT R410A: With this fluid we always suggest to use thicker tubes and reinforced headers as operating pressures are often very high (up to 42 Bars).

GEOMETRY P3012

Single phase coils

Geometry	Tube type	Min. temp.	Max. temp.	Max. pressure	Testing pressure	Max PED Class
P3012	Cu 0.35	-20	100	21	24	ART. 3.3
P3012	Cu 0.40	-20	120	21	24	II
P3012	Cu 0.60	-20	140	16	24	II

Refrigerant condensers and evaporators

Geometry	Tube type	Min. temp.	Max. temp.	Max. pressure	Testing pressure	Max Ø Headers	Max PED Class
P3012	Cu 0.35	-20	80	21	24	108	II
P3012	Cu 0.40	-20	80	26	30	54	II
P3012	Cu 0.40	-20	80	21	24	108	II
P3012	Cu 0.60	-20	80	21	24	108	II
P3012	Cu 0.60	-20	80	42	47	54 *	II
P3012	Cu 0.60	-20	80	42	47	42 *	II

* = With reinforced headers

NOTE: Pressures in Bar, temperatures in °C, headers diameters in mm or “



GEOMETRIES P60 / P40

Single phase coils

Geometry	Tube type	Min. temp.	Max. temp.	Max. pressure	Testing pressure	Max PED Class
P60-P40	Cu 0.40	-20	120	21	24	ART. 3.3
P60-P40	Cu 0.75	-20	140	16	24	II
P60-P40	Cu 1.00	-20	160	16	24	II
P60-P40	Fe 1.50	-10	260	25	30	II
P60-P40	CuNi 1.00	-20	230	16	24	II
P60-P40	Inox 0.60	-20	260	25	30	II
P60-P40	Inox 1.00	-20	260	25	30	II

Steam coils

Geometry	Tube type	Min. temp.	Max. temp.	Max. pressure	Testing pressure	Max PED Class
P60-P40	Cu 0.75	-20	140	16	24	II
P60-P40	Cu 1.00	-20	160	16	24	II
P60-P40	Fe 1.50	-10	300	25	30	II
P60-P40	CuNi 1.00	-20	230	16	24	II
P60-P40	Inox 0.60	-20	260	25	30	II
P60-P40	Inox 1.00	-20	260	25	30	II

NOTE: Pressures in bar, temperatures in °C, headers diameters in mm or “

Refrigerant condensers and evaporators

Geometry	Tube type	Min. temp.	Max. temp.	Max. pressure	Testing pressure	Max Ø Headers	Max PED Class
P60-P40	Cu 0.40	-20	80	21	24	108	II
P60-P40	Cu 0.75	-20	80	24	30	108	II
P60-P40	Cu 1.00	-20	80	24	30	108	II
P60-P40	Cu 1.00	-20	80	42	47	54*	II
P60-P40	Inox 0.60	-20	80	42	47	2"	II
P60-P40	Inox 0.60	-20	80	25	30	4"	II
P60-P40	Inox 1.00	-20	80	42	47	2"	II
P60-P40	Inox 1.00	-20	80	25	30	4"	II



* = With reinforced headers

NOTE: Pressures in Bar, temperatures in °C, headers diameters in mm or “

VERSIONS

Ver 1.2 04-08-2009

Added P40 geometry

Price update

Update frame depth calculation

Update X distance calculation between manifolds

Update Y distance calculation between manifolds

Update D Dimension calculation for ED and COND coils

Added tolerance on calculation

Ver 1.3 10-11-2009

Revision of P3012 performance

NINPUTDATA 100

Added fixed manifold diameter selection (input array)

Added option for basin (input array)

Optimization of manifolds dimension

Added frame dimension on bends side (result array)

Added drop eliminator price option (input array)

Added error nr 19000, 11340, 11350:

Update of materials price

Ver 1.4 16-03-2010

Fixed basin code

Added packing code

Ver 1.5 20-04-2010

Update of materials price

D variable value changed for P40

Improved selection algorithm for manifold dimensions

Fixed correct manifold dimension for ED coils and CU material for 2” and 2”1/2

Improved selection algorithm for monophasic coil

Update AI PR conductivity

Warning 40000 is now an error: two tubes per circuit coils with more than 8 rows are not selected by DLL.

Changed max liquid velocity for condensers

Ver 1.6



Updated standard material of intermediate tray for cost calculation
Update selection algorithm for cooling coils in wet->dry conditions
Added check for aluminum fins 0.25 with 6 mm fins pitch (not a valid combination)
Added calculation option with overall length and number of tubes
Added control for temperature limit on connection without flanges (for monophasic coils and temperature greater than 160°C flanges must be selected: a warning code is issued in vRis[70])
Added check for flanges. This option is not available in this version of the DLL
Bug fix for ED coils selection with R507a and overall dimensions
Price materials are stored in a separate, encrypted file. Future price update only needs a new **przinfo.dlt** file
Connection thickness updated as in Calc98
Fixed manifolds x distance for one row coil
Fixed selection with 5" manifolds

Ver 1.6.0.1

Added aluminum frame for Inox tubes
Added a check for CryptoAPI provider on some Windows XP machine

Ver 1.6.0.2

Fixed problem with outlet manifold diameter description in ris[34]

Ver 1.6.0.3

Added price calculation for multiplier lower than 1.95, added price calculation for reinforced manifolds, added new error codes for missing prices
Changed air side pressure drop for P60 fin pitch 2.5 wet mode
Set maximum number of rows to 25 for finned tubes coils
Changed D dimension calculation for coils with covered box and 1 circuit
Fixed connection material for 4" manifolds

Ver 1.6.0.4

Material prices update on 03.01.2011
Fixed auto fin pitch for P40
Auto fins pitch always starts from 2.0 mm

Ver 1.6.0.5

Review of calculation algorithm to solve additional coils selection for high temperature
Added P40 automatic fin pitch
Added drop eliminators pressure drop in position 61
Fixed pressure calculation for R22 and R134 with evaporating temperature = -1
Fin pitch for AlMg is limited to 3.0 mm
Updated temperature working limits and thickness for tubes (see error codes 11430-11460)
Added packaging price calculation
Improved selection for automatic fin pitch
Improved selection for coils specified with overall dimensions (ED and COND, R410A)
ED coils are always selected with connections on the same side



Added price checks for special brazing AG-H

Ver 1.6.0.6

Changed distance between manifold for 2" , P3012

Fixed selection with a desired outside manifold diameter

Added SetPricePath function

Fixed capacity margin on ED and COND coils with safety on capacity set

Fixed some convergence problem

Changed steam coils manifolds diameters

Added controls on ED max circuit length

Revised selection when overall dimensions are set

Changed frame length for coils with basin and ducted execution

Changed algorithm for selection with overall dimension and number of circuits set.

Added ethilen alcohol - water mixture. Valid percentage from 20% to 50 %. Temperature range -30°C to 30°C

Fixed glycol calculation with weight percentage specified

Fixed calculation with overall length and number of tubes specified.

Changed price calculation for drop eliminator + basin

Prices update with price of raw material dated 11-2011

Changed frame depth for ED and COND coils with minimum value

Changed steam velocity limit for manifolds selection

Ver 1.6.0.7 - Ver 1.6.0.8

Added check on P40 with fin pitch 6.0, which is not available

Revised coil prices

Added prices for CUNI9010 tubes

Revised calculation for INOX 316 tubes

Revised price calculation for INOX distributors

Changed capillars' length for P40 coils

Tube thickness is automatically set based on temperature and/or pressure inlet conditions

Ver 1.6.0.9

Fixed a bug in calculation with automatic fin pitch

Frame depth for P40 has changed

Ver 1.6.0.10

Steam coil description now has VAP instead of AS

Steam coil overall length is now correct for type 3

Steam coil volume calculation has changed

Selection with automatic fin pitch has been optimized and fixed in some cases

Additional check on user input validity



Ver 1.7.0.0

Additional frame codes are now available

Price update

Revision of manifold diameter selection

Revision of heat exchanger performance

Revision of fins pitch and fins thickness

P30 is not available anymore

Brass is not used anymore for headers

Coil weight now includes flanges, if selected, and intermediate plates

Performance laws revision based on last tested coils

P40 is added to automatic coil selection

Manifolds material is automatically assigned as the same as tube material

The capillars pressure drop is now available in the result array, position 76. See page 28 consideration for suggested selection. It's up to the user of the DLL decide to give warnings

Revision of max liquid velocity in manifolds

Added check for FE-INOX tubes: max two rows of connected circuits for every type of coils: Error 130

Added check for max difference between air and liquid fluid: 3°C Warning 41100

Added check for maximum coil size if electro tinned, error 11480

Steam coils: now DLL gives same result on VAP1 configuration for the overall dimensions. Frame thickness for Galvanized steel is 2.00 minimum, for aluminium fins minimum thickness is 2.00 mm. Price Calculation is now aligned with stand-alone software

Steam coils calculation with overall dimensions has been revised

Ver 1.7.0.1

- Added input option for bottom and top frame plate height. The values, if custom, must be both greater than 0. Output array contains the value of bottom and top plate frame given by DBM standard. It is left to the user to check if the coil satisfy DBM manufacturing rules. This option is for testing purpose only.
- Fixed a problem that affects some calculation where user input liquid volume in units different from dm³/h
- Error 41100 is now a warning
- Update P40 frame depth
- Drop eliminator type has been changed to same type as stand alone version, pressured drop changed accordingly.
- Calculation mode 3 (input position 81) is not supported anymore.
-

Ver 1.7.0.2

- Some minor price calculation fixed in both stand alone and DLL version.
- Due to incorrect DLL usage from final users, now DLL forces frame thickness to 2.0 mm minimum



for Steel and Stainless steel tube

- Steam calculation now forces fins thickness to 0.2 mm as stand alone version

-

Ver 1.7.0.3

- New revision of P40 frame depth

Ver 2.0.0.0

- Addition of automatic tube thickness calculation for freon coils. Price correction for Freon coils with reinforced manifolds
- DLL is now built with VC++ 2010

Ver 2.0.0.1

- Revision of dimensions calculation for twin coils in heat recovery
- Added P40 bare tubes coil calculation,
- Reviewed bare tubes coil selection parameters
- Added cost calculation for Stainless steel distributors

Ver 2.0.0.2

- Added fin pitch 6 for P3012
- Fixed cost calculation for recovery coils
- Activated calculation with overall dimensions and number of rows
- Added Dry efficiency calculation for recovery coil at 5/25 temperature and balanced air flow

Ver 2.0.0.3

- Steam properties have been updated with latest formula in literature
- Water properties have been updated with latest formula in literature
- Added R407F
- R404 properties for saturated vapour have been updated
- Calculation for condensing coil has been updated
- Frame thickness is now automatically calculated for recovery coils

Ver 2.1.0.0

- Frame thickness is now automatically calculated for recovery coils
- Recovery coils calculation contains selection algorithm to obtain performance in accordance with ECODesign regulation.
- Price update